
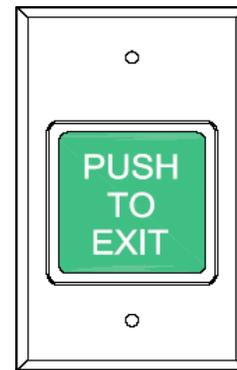


**INSTALLATION INSTRUCTIONS**  
**MODEL 2973 PUSH SWITCH**  
**FIXED 30 SECOND TIME DELAY**

This push to exit button is specifically intended for installation on Access Controlled Egress doors as described in the Boca code. A motion detector is the primary means of releasing a magnetic lock on the door. The push to exit button is intended, as a back up means of releasing the lock in the event there is a problem with the motion detector. When the button is pressed, the lock releases for 30-seconds. If pressed again during the 30-seconds lock release period, the unit will "Retrigger" starting a new 30-second lock release period.

**TYPICAL WIRING**

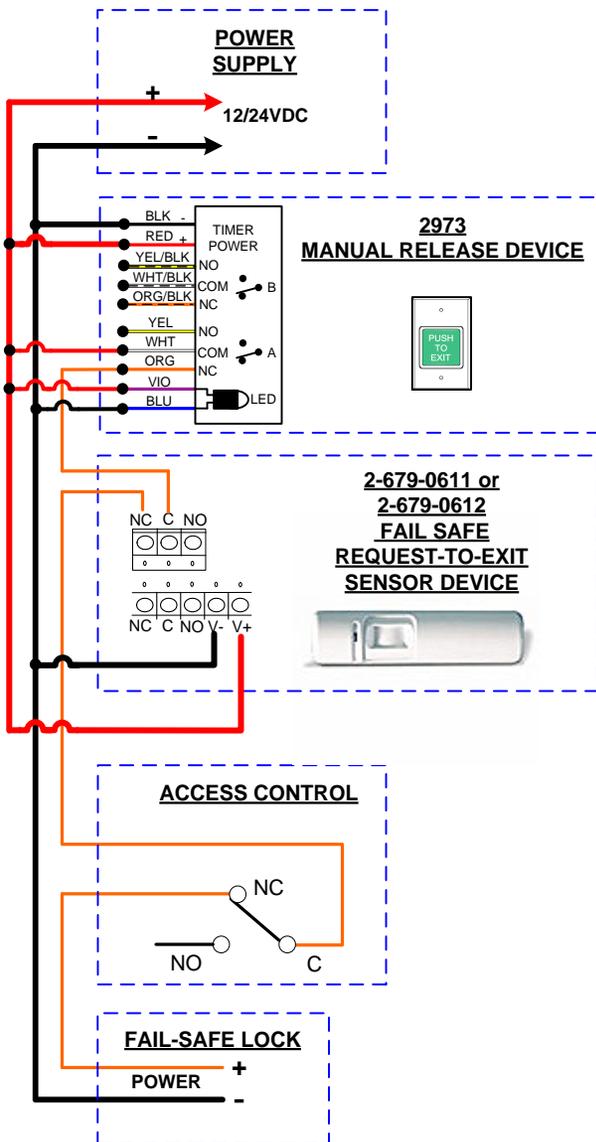

**2973**

**Electrical Specifications**

- Input Voltage : 12/24VDC @90ma.
- LED Indicator : 12/24VDC @ 10/20ma
- Output Relay: DPDT
- Max Load : 30VDC @ 5 AMP (Resistive)

**LED Options**

**LED Wiring (LEDG, LEDR, or 2LED Options)**

