


The power supply monitoring module provides outputs to monitor Hager 2909 power supply status. A separate set of SPDT relay contacts are provided to monitor AC power and DC output/battery status. Battery operation can be monitored via the battery status contacts upon loss of AC power.

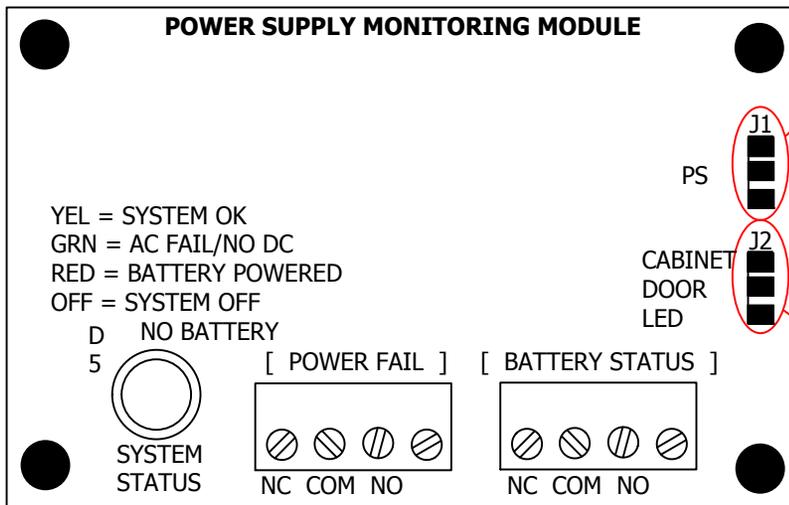

Attached one end of cable supplied with the monitor module to J1. Attach the other end to J6 on the power supply circuit board.

Attach LED cable from power supply to J@ on monitor module.

### Specifications

2 SPDT 1 amp relay outputs.  
On/Off status.  
Size: 3.25" (83mm) W x 2.00" (51mm) H.  
Works with Hager 2909 Power Supply. Requires 1 Module space.  
Supplied with mounting screws and standoffs for J-box mounting.